



Low-Pressure Pipe Systems

Project funded by the U.S. Environmental Protection Agency under Assistance Agreement No. CX824652

Introduction

Less than one-third of the land area in the U.S. has soil conditions suitable for conventional soil absorption systems. Numerous innovative alternatives to the conventional septic tank soil absorption system have evolved in response to the demand for an environmentally acceptable and economical means of disposing domestic wastewater onsite and the restrictive soil conditions common in many states. Although not an alternative to all unsuitable soils, the low-pressure pipe (LPP) system has proven to be useful for some specific conditions where conventional systems failed frequently.

Originating in North Carolina and Wisconsin, an LPP system is a shallow, pressure-dosed soil absorption system with a network of small diameter perforated pipes placed 10 to 18 inches deep in narrow trenches 12 to 18 inches wide.

4) pressure-dosed with uniform distribution of the effluent, 5) design based on areal loading, and 6) resting and reaeration between doses.

Process Description

The main components of an LPP system (see Figure 1) are:

- a septic tank or an aerobic unit;
- pumping (dosing) chamber (submersible effluent pump, level controls, high water alarm, and supply manifold); and
- small diameter distribution laterals with small perforations (holes).

The septic tank is where settleable and floatable solids are removed and primary treatment occurs. Partially clarified effluent then flows by gravity to a pumping chamber where it is stored until it reaches the level of the upper float control, which activates the pump. The level controls are set for a specific pumping sequence of one to two times daily, with each dose providing five to

10 times the lateral pipe volume, allowing breaks between doses for the soil to absorb the effluent. The pump turns off when the effluent level falls to the lower float control.

However, the dosing mecha-

nism and frequency may vary for different systems. The pumping chamber is usually sized to provide excess storage of at least 1 day's capacity (above the alarm float) in case there is a power failure or pump malfunction. If the pump or level controls should fail, the effluent would rise to the level of the alarm control, turning the alarm on.

The pump moves the effluent through the supply line and manifold to the distribution

continued—

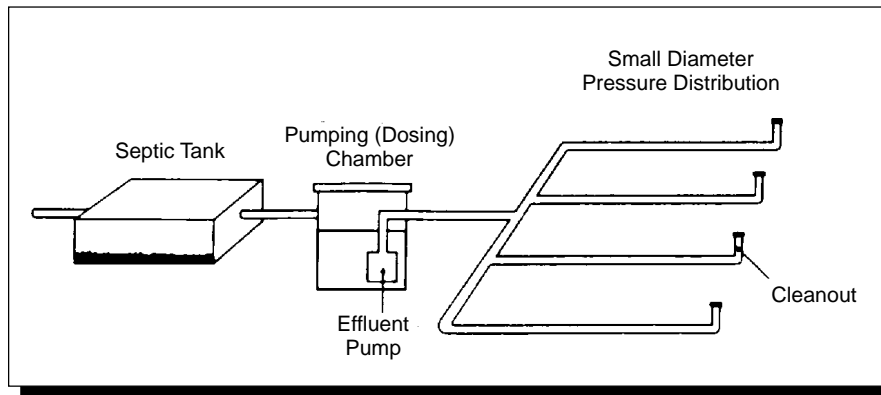


Figure 1: Low-Pressure Pipe System

Source: U.S. Environmental Protection Agency (1992)

LPP systems were developed as an alternative to conventional soil absorption systems to eliminate problems such as: clogging of the soil from localized overloading, mechanical sealing of the soil trench during construction, anaerobic conditions due to continuous saturation, and a high water table. The LPP system has the following design features that overcome these problems: 1) shallow placement, 2) narrow trenches, 3) continuous trenching,

This fact sheet was developed by Clement Solomon, Peter Casey, Colleen Mackne, and Andrew Lake.

©1998 by the National Small Flows Clearinghouse



laterals in the trenches under a low pressure (about 3 to 5 feet of pressure head). These laterals are a network of PVC pipes that have small, drilled perforated holes usually 5/32 to 1/4 inches in diameter, and spaced at 2 1/2 to 5 feet intervals (exact dimensions are determined for each system).

The laterals are placed in narrow gravel-filled trenches 10 to 18 inches deep and spaced 5 or more feet apart. The narrow trenches allow enough storage volume so that the depth of the effluent does not exceed 2 or 3 inches of the total trench depth during each dosing cycle.

Advantages and Disadvantages

Some advantages and disadvantages of LPPs are listed below:

Advantages

- Shallow placement of trenches in LPP installations promotes evapotranspiration and enhances growth of aerobic bacteria.
- Absorption fields can be located on sloping ground or on uneven terrain that would otherwise be unsuitable for gravity flow systems.
- Improved distribution through pressurized laterals disperses the effluent uniformly throughout the entire drainfield area.
- Periodic dosing and resting cycles enhance and encourage aerobic conditions in the soil.
- Shallow, narrow trenches reduce site disturbances and thereby minimize soil compaction and loss of permeability.
- LPPs allow placement of the drainfield area upslope of the home site.
- LPPs have reduced gravel requirements.
- There is a significant reduction in land area required for the absorption system.
- Costs are comparable to other alternative typical distribution systems.
- LPPs overcome the problem of peak flows associated with gravity-fed conventional septic systems.

Disadvantages

- In some cases, the suitability could be limited by soil, slope, and space characteristics of the location.
- A potential exists for clogging of holes or laterals by solids or roots.
- LPPs have limited storage capacity around their laterals.
- There is the possibility of wastewater accumulation in the trenches or prolonged saturation of soil around orifices.
- LPPs could experience moderate to severe infiltration problems.
- Regular monitoring and maintenance of the system is required; lack of maintenance is a sure precursor to failure.

Performance

Two critical factors that affect the performance of an LPP system are dosing and distribution of the effluent. The dosing and resting periods help maintain aerobic conditions in the soil and around the distribution trench. An LPP system cycles back and forth between aerobic and anaerobic conditions, which can lead to favorable conditions for nitrification and denitrification. During the aerobic resting period, nitrification occurs. When the system is loaded with wastewater, anaerobic conditions result in denitrification.

Uniform distribution cannot be overemphasized in the performance of any LPP system. The effluent must be distributed evenly over the soil absorption field without hydraulically overloading it.

The four factors that affect the suitability of an LPP system for a given site are the soil, slope, available space, and anticipated wastewater flow.

Soil Requirements

An LPP system should be located in soils that have suitable or provisionally suitable texture, depth, consistence, structure, and permeability, according to state/local regulations. A minimum of 12 inches of usable soil is required between the bottom of the absorption field trenches and any underlying restrictive horizons, such as consolidated bedrock or hardpan, or to the seasonally high water table. A minimum of 20 to 30 inches of soil depth is needed for the entire trench.

Space Requirements

The distribution network of most residential LPP systems uses about 1,000 to 5,000 square feet of area, depending on the soil permeability and design waste load. An area of equal size must also be available for future repair or replacement of the LPP system. If the space between the lateral lines will be used as a repair area, then the initial spacing between the lateral lines must be 10 feet or wider to allow sufficient room for repairs. Although size requirements for an LPP system will vary depending on the site, in general an undeveloped lot smaller than 1 acre may not be suitable for an LPP system.

Drainage Requirements

The septic tank, pumping chamber, and distribution field should never be located in areas where hydraulic overloading could occur from surface runoff.

Two critical drainage requirements are surface water diversion and interception of shallow perched waters upslope of the system. These conditions are most important on sites with concave or lower slope positions with soils having a restrictive horizon near the surface. Surface water and perched groundwater must be diverted away from the LPP system.

Topography

There are special design considerations for LPP distribution fields located on slopes. The distribution field must be elevated higher than the pumping chamber so that gravity does not cause the effluent to flow out of the pumping chamber and into the distribution field when the pump is not operating. If the topography does not allow for the distribution field to be elevated, then the LPP system must be designed to ensure that effluent will not leave the pumping chamber when the pump is turned off (e.g., use of an anti-siphon hole or other control in the discharge piping in the pumping chamber).

Application

Chatham County, North Carolina

A study was conducted in Chatham County, North Carolina, to evaluate the effectiveness of a sand filter/LPP system in slowly permeable soils of a Triassic Basin. Subobjectives of this study were to evaluate the operation and functioning of

continued—

system components, assess treatment effectiveness of a buried pressure-dosed sand filter, and determine the hydraulic capacity and wastewater treatment potential of this soil profile.

The system included a 1,000-gallon septic tank, a Tyson flow splitter, two 1,000-gallon dosing tanks, a pressure-dosed buried sand filter, and two similar side-by-side LPP drainfields. One drainfield was dosed with septic tank effluent while the other drainfield received sand filter effluent. This system was designed for a three-bedroom house and started operating in August 1988.

One-half of the effluent from the septic tank flowed into Pump Tank 1 that dosed the sand filter. Effluent from the sand filter drained into a dosing tank and was then pumped to the first drainfield. The second half from the septic tank flowed into Pump Tank 2 that dosed the other LPP field. The LPP system consisted of lateral pipes (PVC) 1.25 inches in diameter with 5/32 and 9/64 inch holes and buried in trenches 10 inches wide. The design loading rate on the drainfield was 0.13 gallons per day per square foot, and each drainfield contained eight laterals on 5-foot centers.

It was observed during this study that the electrical and mechanical components performed quite well. There was excellent removal of fecal coliform organisms within 10 feet downslope of both drainfields, and little to no $\text{NO}_3\text{-N}$ and $\text{NH}_4\text{-N}$ were detected in perched waters downslope of the LPP drainfield receiving sand filter effluent. The excellent nitrogen removal was a result of the nitrification that occurred in the sand filter and denitrification that occurred due to shallow placement in a biologically active saturated zone.

The system performed well except for some partial clogging of the pressure distribution systems, breakage of some lateral turnups, and infiltration of perched water into the tanks. Extensive flushing of solids and fecal coliform occurred when there were large rainfall events (a 4-inch downpour associated with a hurricane). These observations indicate that the tanks should be watertight and require greater oversight and maintenance than conventional systems.

Operation and Maintenance

A properly designed and installed LPP system requires very little ongoing maintenance. However, periodic inspection and maintenance by professional operators is required for continued performance. Studies have documented a 40 to 50% failure rate when maintenance was left to the homeowners rather than professionals. North Carolina now requires a minimum monitoring frequency of every 6 months by certified subsurface system operators.

The septic tank and pumping chamber should be checked for sludge and scum buildup and pumped as needed. Screens or filters can be used to prevent solids from escaping the septic tank. However, some solids may accumulate at the end of the lateral lines, which should be flushed out once a year. Turnups installed at the distal ends of laterals facilitate this process.

The manufacturer's recommendations should be followed when servicing an LPP system in order to ensure longer life and proper function of the pumps and other mechanical/electrical components of the system. The pump should be removed annually for cleaning and inspection. (Pump replacements

should be selected based on the specific system design rather than the horsepower rating.) The pump must be checked for signs of oil leakage, worn or broken components, or any damaged parts that should be replaced. When reinstalling the pump, check the level switches to ensure proper operation. An elapsed run-time meter and pump impulse counter should be installed within the control panel to facilitate system troubleshooting and monitoring of performance.

In the event of a power failure or pump malfunction, a visible and audible alarm is activated when the effluent rises to the level of the alarm control. The alarm should be located at the control panel to facilitate testing by the professional operator.

Table 1 below lists some general operation and maintenance (O&M) tasks for large LPP systems:

Table 1: General Maintenance Schedule

Component	O&M Requirement
Collection system Septic tank	Check for I/I and blockages. Check for solids accumulation, blockages, or damage to baffles, and excess I/I. Pump septage as required.
Pumping chamber	Check pumps, controls, and high water alarm. Check for solids accumulation and pump as required; check for I/I.
Supply lines	Check for pipe exposure and leakage in force mains.
Soil absorption field	Provide maintenance of field and field's vegetative cover; repair broken lateral turnups. Check for erosion and surfacing of effluent. Check pressure head and flush out lateral lines.

Adapted from: Marinshaw (1988) with permission

Although the LPP system overcomes many of the problems associated with the conventional septic tank system, there has been documentation of some operational problems with small, poorly maintained, onsite LPP systems in North Carolina. Large LPP systems in North Carolina have shown to have similar problems as well, but on a larger scale because of the size of the systems. Careful site-specific designs and regular maintenance by trained, professional operators are the keys to overcoming these problems. Large LPP systems can have problems such as:

- *Excess infiltration:* Drainfields are very susceptible to hydraulic overloading due to infiltration. In areas with improper drainage, leaky pump tanks can become sinks for nearby groundwater. Large systems that include extensive collection sewers have a higher probability of inflow/infiltration. Watertight septic tanks and pumping chambers are the keys to system performance.
- *Faulty hydraulic design:* For optimum performance of the system, the pumps, supply lines, manifold, laterals, and orifices must be properly designed, sized, and located. Improper hydraulic design can result in problems such as localized overloading, excessive head loss, and nonuniform distribution. The dosing volume must be large enough (five to 10 times the lateral pipe volume) to adequately pressurize the pipe network. The manifold should feed the highest lateral first to improve effluent distribution to the drainfield.

continued—

- *Drainage*: Surface runoff must be diverted away from the LPP system. If the water table becomes high in level sites, groundwater beneath community-scale LPP systems can mound up into soil absorption field trenches and cause failure. The trenches on sloping fields can experience hydraulic overloading due to subsurface flow from higher areas.
- *Improper installation*: The performance of an LPP system is sensitive to any variations in hydraulic design; therefore, proper installation is essential. Some common installation problems are incorrect orifice size and spacing, installation of undersized substitute pumps, incorrect adjustment of level control floats and pressure head, installation of laterals at incorrect elevations, and failure to install an undisturbed earth dam in each trench where the manifold feeds each lateral. Earth dams are used at the beginning of each lateral trench to prevent redistribution of effluent from higher trenches to those lower on the landscape. Dams are not used elsewhere in the trenches.
- *Orifice and lateral clogging*: Poor septic tank maintenance can result in solids reaching the soil absorption field and clogging the orifices. In some older LPP systems, it was observed that slime had built up in long supply lines and manifolds and laterals. Current practice includes sleeving the small diameter laterals within 4-inch diameter corrugated drainage tubing or drainfield pipe and laying the small diameter distribution laterals such that the perforations point upward.

Cost

The cost of an LPP system depends on the contractor, the manufacturers, the site, and the characteristics of the wastewater. The overall cost of an LPP system is also largely determined by the capital and O&M expenses. The annual operating costs for LPPs include power consumption for the pumps, pipe and other miscellaneous equipment repair, replacement of the components, and monitoring costs for a professional operator.

In a 1989 study of LPP use among different counties in North Carolina, it cost an average of \$2,600 to install an LPP system for a three-bedroom house. The average installation cost across counties ranged from \$1,500 to \$5,000 and was inversely related to the extent of LPP use within a county. Therefore, the more LPP systems that are installed within a community, the less the cost per system.

References

- Amoozegar, A.; E. W. West; K. C. Martin; and D. F. Weymann. Dec. 11–13, 1994. “Performance Evaluation of Pressurized Subsurface Wastewater Disposal Systems.” On-Site Wastewater Treatment: Proceedings of the Seventh International Symposium on Individual and Small Community Sewage Systems. Atlanta, Georgia.
- Bomblat, C.; D. C. Wolf; M. A. Gross; and E. M. Rutledge. December 11–13, 1994. “Field Performance of Conventional and Low Pressure Distribution Septic Systems.” On-Site Wastewater Treatment: Proceedings of the Seventh International Symposium on Individual and Small Community Sewage Systems. Atlanta, Georgia.
- Carlile, B. L. December 6–7, 1985. “Soil Treatment Systems for Small Communities.” Proceedings of a Workshop on

Utilization, Treatment, and Disposal of Waste on Land. Soil Science Society of America. pp. 139–146. Madison, Wisconsin.

- Cogger, C. G.; B. L. Carlile; and D. J. Osborne. 1982. “Design and Installation of Low-Pressure Pipe Waste Treatment Systems.” UNCA Sea Grant College Publication UNC-SG-82-03. North Carolina State University. Raleigh, North Carolina.
- Hargett, D. L. 1984. “Technical Assessment of Low-Pressure Pipe Wastewater Injection Systems.” MERL. ORD. U.S. Environmental Protection Agency (EPA). Cincinnati, Ohio. Project Report Under Contract 68-03-3057, by RSE, Inc. Madison, Wisconsin.
- Hoover, M. T. and A. Amoozegar. Sept. 18–19, 1989. “Performance of Alternative and Conventional Septic Tank Systems.” Proceedings of the Sixth Northwest On-Site Wastewater Treatment Short Course. pp. 173–203. University of Washington. Seattle, Washington.
- Hoover, M. T.; A. Amoozegar; and D. Weymann. 1991. “Performance Assessment of Sand Filter: Low Pressure Pipe Systems in Slowly Permeable Soils of a Triassic Basin.” On-Site Wastewater Treatment: Proceedings of the Sixth National Symposium on Individual and Small Community Sewage Systems.
- Hoover, M. T.; T. M. Disy; M. A. Pfeiffer; N. Dudley; and R. B. Mayer. 1995. *On-Site System Operation and Maintenance Operators Manual*. The National Environmental Training Center for Small Communities (NETCSC). West Virginia University. Morgantown, West Virginia.
- Marinshaw, R. J. Feb. 8–9, 1988. “Design of Large Low-Pressure Pipe Distribution Systems in North Carolina.” Presented at the National Environmental Health Association, Mid-Annual Conference. Mobile, Alabama.
- Sump and Sewage Pump Manufacturers Association (SSPMA). 1998. “Recommended Guidelines for Sizing Effluent Pumps.” SSPMA. Northbrook, Illinois.
- Uebler, R. L. 1982. “Design of Low-Pressure Pipe Wastewater Treatment Systems.” 1982 Southeastern On-Site Sewage Treatment Conference Proceedings. North Carolina Division of Health Services and the Soil Science Department. North Carolina State University.
- U.S. Environmental Protection Agency. May 1992. “Small Wastewater Systems: Alternative Systems for Small Communities and Rural Areas.” EPA Office of Water. 830/F-92/001.

The mention of trade names or commercial products does not constitute endorsement or recommendation for use by the National Small Flows Clearinghouse (NSFC) or U.S. EPA.

For more information on low-pressure pipe systems or a list of other fact sheets, contact the NSFC at West Virginia University, P.O. Box 6064, Morgantown, WV 26506-6064. Phone: (800) 624-8301 or (304) 293-4191. Fax: (304) 293-3161. World Wide Web site: <http://www.nsfv.wvu.edu>.

The NSFC provides free and low-cost informational services and products to help homeowners and small communities address their wastewater needs. Also, information about manufacturers, consultants, regulations, and facilities can be obtained from the NSFC's databases.