

Pipeline




Small Community Wastewater Issues Explained to the Public

Drainfield Rehabilitation

The septic system, once thought of as a temporary solution for the treatment of domestic wastewater, is still the best choice for homes or residences and small communities where it would be cost-prohibitive to access public sewer systems. In the U.S., these onsite systems collect, treat, and release about four billion gallons of wastewater per day from an estimated 26 million homes.

Current interest in the impact of these systems on groundwater and surface water quality has increased interest in optimizing the systems' performance. It is now accepted that these onsite systems are not just temporary installations that will eventually be replaced by centralized sewers, but are a permanent part of the wastewater infrastructure.

Septic systems are typically simple in design, which make them generally less expensive to install and maintain. And by using natural processes to treat the

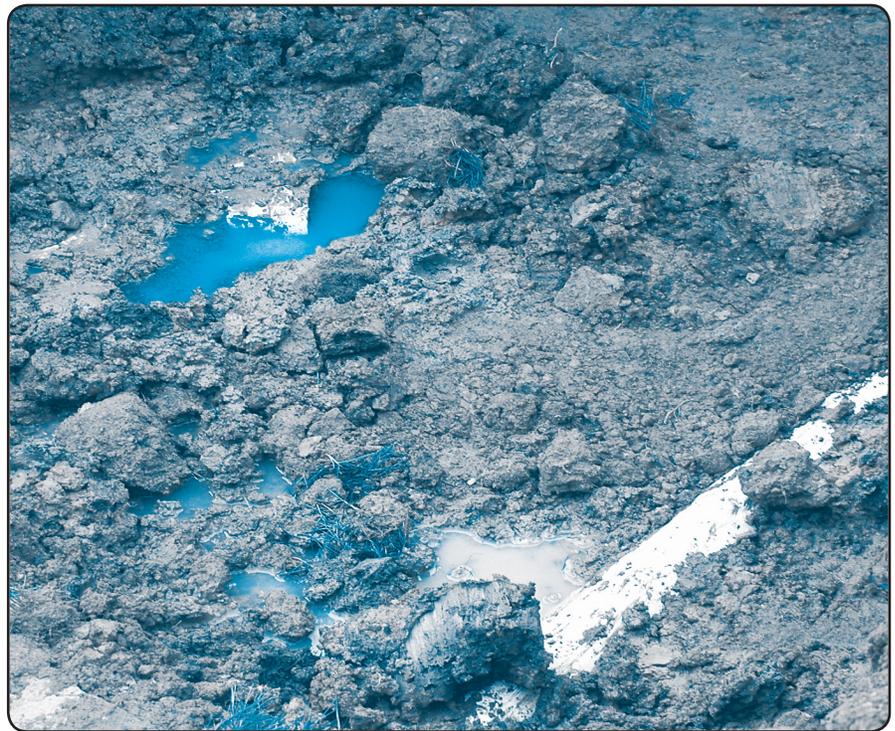

Wastewater rising to the surface or "ponding" as a result of a failed drainfield.

wastewater onsite, usually in a homeowner's backyard, septic systems don't require the installation of miles of sewer lines, making them less expensive and less disruptive to the environment. In addition, there are many innovative designs for septic systems that allow them to be placed in areas with shallow soils or other site-related conditions previously considered to be unsuitable for on-lot treatment and dispersal.

Although the septic tank settles out most of the heavier solids and breaks down almost half of

the suspended solids from household wastewater, the effluent still has a high amount of biodegradable organic materials along with a high bacterial content that may include pathogens. Therefore, septic tank effluent is not suitable for direct discharge into surface waters or onto land surfaces. Further treatment is needed to remove these harmful pathogens. The most common way to do this and dispose of the partially treated wastewater is through subsurface soil absorption through the drainfield.

Septic systems were never intended

What's Inside...

Drainfield Rehabilitation.....	1
Biomat Formation	3
Do Not Flush.....	4
Alternating Drainfields.....	7
Related Products	8

for lifetime use without maintenance. Neglecting maintenance of system components only leads to failures. When properly designed, installed, and maintained, septic systems have a minimum life expectancy of 20 to 30 years.

The U.S. Environmental Protection Agency (EPA) *Onsite Wastewater Treatment Systems Manual* (2002) defines system failure as “a condition where performance requirements are not met.” Typically, failures are declared when wastewater is observed on the surface of the ground or is backing up into the household plumbing.

When a septic system fails, it can pollute nearby water resources and endanger public health. Children are most susceptible to these health problems because they very often come into contact with the contaminated areas.

There’s really not all that much

that is going to go wrong with the septic tank itself as long as it is watertight and pumped on a regular basis. (Table 1 gives approximate pumping frequencies.) However, what usually fails is the soil absorption system.

The soil absorption system, or drainfield, is an arrangement of perforated pipes or chambers buried underground that channel the pre-treated wastewater—the liquid discharge (effluent) from the septic tank—out over a large area of the soil. The effluent then moves slowly down through the soil to become naturally purified before returning to the aquifer. The drainfield acts as a natural filter for effluent by absorbing the organic materials, reducing or removing bacteria and viruses, and removing some nutrients.

The most obvious sign of drainfield failure is surfacing effluent. If the soils can no longer accept the effluent being delivered, the effluent will either rise to the ground surface, or ‘blow out’ at the end of the last trench. Either of these two events should alert the homeowner that there is a problem.

The reason the soil can no longer accept the pre-treated effluent is most often because of the biomat. As the effluent or pre-treated wastewater enters the drainfield, bacteria in the soil begin to thrive on the new food source. As these bacteria grow, they form a thick slimy colony called the biomat that restricts the flow of effluent to the surrounding soil. (See sidebar on page 3.)

Causes for failure are many and varied—ranging from improper siting, design, or construction, to the simple overuse of water-generating appliances. It is vital that the exact cause for the failure is determined before attempting any remediation to the system.

The suggested process for correct-

Table 1.

Estimated septic tank pumping frequencies in years. These figures assume there is no garbage disposal unit in use. If one is in use, pumping frequency may need to be increased.

Tank Size (gals.)	Household Size (number of people)					
	1	2	3	4	5	6
500	5.8	2.6	1.5	1.0	0.7	0.4
750	9.1	4.2	2.6	1.8	1.3	1.0
900	11.0	5.2	3.3	2.3	1.7	1.3
1000	12.4	5.9	3.7	2.6	2.0	1.5
1250	15.6	7.5	4.8	3.4	2.6	2.0
1500	18.9	9.1	5.9	4.2	3.3	2.6
1750	22.1	10.7	6.9	5.0	3.9	3.1
2000	25.4	12.4	8.0	5.9	4.5	3.7
2250	28.6	14.0	9.1	6.7	5.2	4.2
2500	31.9	15.6	10.2	7.5	5.9	4.8

(Source: Pennsylvania State University Cooperative Extension Service.)

ing system failure is to gather information about the system, determine the cause of failure, and design the corrective action. These steps will be discussed in detail in this issue of *Pipeline*.

Causes of failure

Drainfield failure can be caused by many things, including excessive rainfall, tree roots interfering with the drainlines, or vehicles driving over the system and cracking pipes. But the two most common causes are: hydraulic and biological overloading. Hydraulic overloading occurs when too much water is sent to an under-designed system. Biological overloading is the result of too much organic matter in the effluent.

The initial design of a system is based on soil and site characteristics, including depth to groundwater or bedrock. Part of the design includes the system’s capacity that takes into account the number of people living in the home. Capacity is usually based on the



Pipeline

Pipeline is published quarterly by the National Environmental Services Center at West Virginia University, P.O. Box 6064, Morgantown, WV 26506-6064

Pipeline is funded through a grant from the U.S. Environmental Protection Agency Washington, D.C.

Steve Hogye—Project Officer
Municipal Support Division
Office of Wastewater Management

Rick Phalunas — Interim Division Manager
Marilyn Noah — Editor
Jennifer Hause — Technical Advisor
Ed Winant PE — Technical Advisor
John Fekete — Senior Graphic Designer
Jamie Bouquot — Graphic Designer

Permission to quote from or reproduce articles in this publication is granted when due acknowledgement is given. Please send a copy of the publication in which information was used to the *Pipeline* editor at the address above.

an equal opportunity/affirmative action institution



ISSN 1060-0043

The contents of this newsletter do not necessarily reflect the views and policies of the U.S. Environmental Protection Agency, nor does the mention of trade names or commercial products constitute endorsement or recommendation for use.

number of bedrooms in the home, but this may not be an accurate way to determine flow generation. Extra people or the addition of a hot tub, for instance, can quickly create more wastewater than the system and drainfield can handle.

The addition of appliances, such as garbage disposals and dishwashers, can greatly change the quality of the wastewater sent to the system. These appliances send increased amount of solids to the system, possibly causing biologic overloading. Use these appliances in moderation, keeping in mind that a garbage disposal is not a waste receptacle.

Many local and state regulatory authorities require onsite systems to be sized larger to handle the additional load from such appliances as a garbage disposals. Check with your local health department or permitting authority to see if this is the case in your area. Telephone numbers of such agencies are normally listed in the government or blue pages of the local telephone directory.

Septic system failure can also result from:

- Overloading with water. Homeowners should avoid putting too much water into the system at one time; stagger laundry loads throughout the week rather than having a 'wash day' where you might do all the laundry within a 24-48 hour period. Divert your hot tub away from your onsite system when draining it.
- Discarding decay-resistant materials into the system such as grease, sanitary napkins, and other solids.
- Allowing tree roots to clog or destroy the absorption system.
- Compacting soil over the drainfield. Avoid driving or parking vehicles over the drainfield.
- Age of the system. Septic sys-

Biomat Formation

As the effluent is discharged into the soil absorption system, bacterial growth develops beneath the distribution lines where they meet the gravel or soil. This layer is known as the clogging mat, clogging zone, biocrust, and biomat. This biomat (biological mat) is a black, jelly-like layer that forms along the bottom and sidewalls of the drainfield trench. This clogging zone reduces infiltration of the wastewater into the soils.


The biomat is composed of anaerobic microorganisms (and their by-products) that anchor themselves to soil and rock particles. Their food is the organic matter in the septic tank effluent. Less than one centimeter to several centimeters thick, the biomat acts as the actual site for effluent treatment.

The biomat forms first along the trench bottom near the perforations where the effluent is discharged, and then up along trench walls. It is less permeable

than fresh soil, so incoming effluent will move across the biomat and trickle along the trench bottom to an area where there is little or no biomat growth. (See growth pattern diagram below.)

Biomats tend to restrict the flow of effluent through the drainfield, but are crucial because they filter out viruses and pathogens. As the biomat develops, the soil infiltration rate decreases. Once the hydraulic loading rate exceeds the soil infiltration rate, ponding starts. At some point wastewater will either back up into the home or break out on to the soil surface.

Biomat formation cannot, and should not, be prevented, but septic tank filters, proper organic loading, and proper maintenance of the septic tank can slow the rate at which it forms. Septic tank filters prevent excess suspended solids from flowing into the drainfield and can be retrofitted to existing systems.

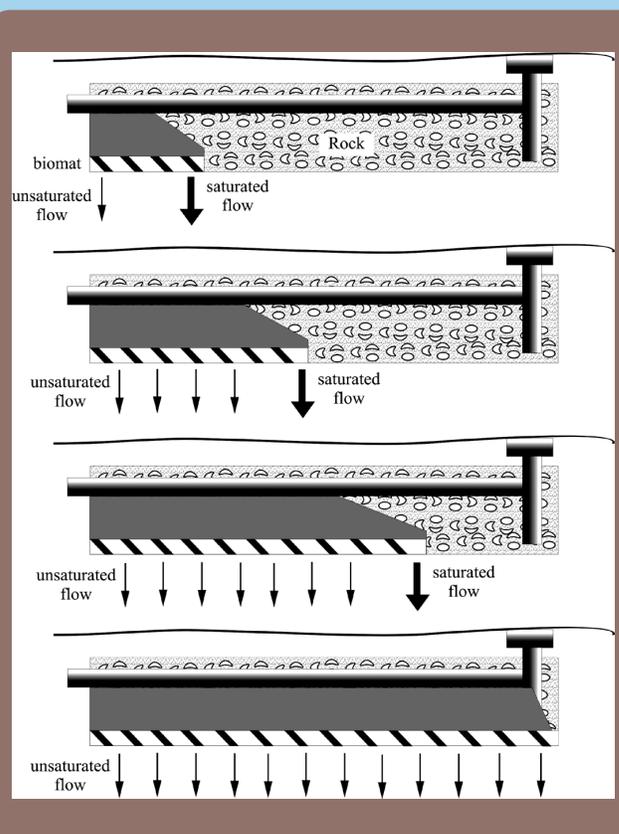

Other maintenance that should be performed on the septic system includes having the system inspected and the tank pumped at regular intervals. Pumping the tank allows it to better settle out solids, also reducing the organic load to the drainfield. (The Fall 2004 *Pipeline* provides detailed guidelines for septic system maintenance.)

tems are designed for an operational life of 20 to 30 years. If you have an aging system, it may be time to inspect and replace it.

The Correction Procedure

When an onsite system fails it is important to gather specific information about the system in order to diagnose the problem and determine the appropriate corrective action.

Initial data gathering

- Visual observation of the failure should be made to confirm the problem. All system components should be inspected, and any mechanical components (such as float switches and flow diverters) should be tested by a qualified/certified system inspector.
- A complete history of operation

and maintenance of the system should be reviewed. Frequently, a study of the past three to five years of operation and maintenance will reveal a possible problem. The correction may be as simple as pumping the tank or cleaning a tank filter.

- Obtain a copy of the original permit and any updates. This permit will contain a layout of the system from a site survey or drawings of the original design.
- Determine approximate loading rates from the original design and permit.
- Soil test results should be reviewed. If soil test results are not included in the permit, soil samples should be taken to determine the soil profile and to locate any soil boundaries that may be present. The age of system should also be determined.
- Obtain a complete report of the symptoms of failure. For example, surfacing effluent above the drainfield suggests that the soil may be overloaded, either with too much total water or that the water has inappropriate amounts of organic matter that has clogged the soil pores. Additionally, if the failure is seasonal, wet weather conditions are likely to be the cause.
- Determine the amount of wastewater entering the system. Using data from the dwelling's water meters, actual flow (even if estimated) is then compared to the design loadings. This will yield a good approximation of how much wastewater is entering the wastewater system. Leaking plumbing fixtures will skew this number causing more water to enter the system. Thus, all leaking fixtures must be repaired.

Determining the cause

From the information gathered through the above steps, ideas about the potential causes of failure should come to light. It might be necessary to do some additional steps to test the idea before any corrective actions are

taken. Wastewater metering or testing, equipment testing and monitoring, or additional soil testing might help more clearly define the cause of the system failure.

Repair permits may be required before any corrective action begins. Contact your local health department or permitting agency to find out what is required to obtain such a permit.

Remediation techniques

There are various repair or remediation techniques that may be considered, depending on the investigation into the causes of failure as described above, economic considerations, and the flexibility of the local permitting entities. State and local statutes vary as to what technologies are permitted. Homeowners must work closely with their local health departments or permitting authorities to make the best choice for their individual situation.

Short-term solutions

If the neighborhood is soon to receive public sewerage, it might be practical to use a short-term technique such as water conservation. But conservation and other management techniques are only part of most solutions. Drainfield failure must be considered a serious health hazard and as such, should be taken care of with long-term goals in mind.

Sometimes the overloaded drainfield can recover if a strict policy of water conservation is observed by the homeowner. After pumping the septic tank and replacing water-guzzling appliances with more efficient ones, repairing leaking fixtures, staggering showers and clothes washing times to reduce the output of effluent

If the soil around the piping is allowed to dry out, it may be able to function properly once again. This method obviously requires a good deal of home-

Do Not Flush...



- Coffee grounds
- Dental floss
- Disposable diapers
- Kitty litter
- Sanitary napkins
- Tampons
- Cigarette butts
- Condoms
- Fat, grease, or oil
- Paper towels
- Unused household cleaning solutions or pharmaceuticals

Or hazardous chemicals such as:

- Paints
- Varnishes
- Thinners
- Waste oils
- Photographic solutions
- Pesticides

These items can overtax or destroy the biological digestion taking place within your system.

owner commitment. It usually takes a 30 percent reduction in water use to allow the drainfield to recover.

In cases of physical damage, system restoration may only require the leveling of the distribution box or repairing crushed or broken pipe. If tree roots are interfering with the operation of the soil absorption field, they can be removed. Broken or deteriorated baffles in the septic tank can allow solids to go to the drainfield; these should be replaced or repaired.

There are now some new technologies that may provide temporary relief to drainfield failure. The first is "jetting," a procedure that utilizes special pumps to inject high-pressure water into the drainlines to break up silt deposits and other solids, coupled with powerful vacuum lines that suck the broken-up solids out of the lines before they can settle again.

If the problem stems from poor or compacted soil, hope may come in the form of another new-technology solution known as "soil fracturing." Highly specialized equipment uses a pneumatic hammer to drive narrow probes down into the soil of the drainfield, typically to a depth of between three and six feet.

Air is then forced into the soil at a controlled rate, which fractures the hard soil and creates tiny open channels through it. Next, polystyrene pellets are injected into the newly aerated soil, which keeps the passages open so the soil will not simply compact again. This technology has met with mixed results and is only approved by certain states. It is very important to check with your local health officials to find out what similar process (if any) is approved for your situation.

Some of these more extreme procedures may provide some temporary relief for a failing system that is soon to be replaced or connected to a municipal system.



Damaged, waterlogged areas in the lawn over the drainfield indicate drainfield system failure.

In many states, the process falls between the regulatory cracks whether or not it is a repair and requires a repair permit.

Long term solutions

In some cases, corrective measures are not enough; a new soil absorption system must be constructed. New soil absorption systems can be placed either in an isolated area so the old system is not disturbed in the process or in between the existing trenches if there is adequate room. These additional lines are considered part of an alternating drainfield system.

A diversion valve is installed so that in the future it will be possible to direct the flow from the septic tank to either of the soil absorption systems. After the new drainfield is in place, the flow is diverted from the old field that will slowly rejuvenate itself and be available for use in the future.

The rejuvenation process takes about two years and involves naturally occurring organisms, which decompose the clogging mat that has formed and return the absorptive system to near original capacity. (The old drainfield can recover faster if a septic

Table 2

Signs of impending drainfield failure:

- Sluggish drains and toilets in the home
- Odor of sewage in the house and/or outdoors

Signs that drainfield failure has occurred:

- Sewage backing up into the home
- Ponding in the yard above or near the drainfield
- Soil sinking or collapsing over any part of the system

tank pumper can open the field and remove as much of the ponded wastewater as possible.)

After a replacement system has been installed, a homeowner should switch back to the old drainfield after two years, and then switch back and forth between the two systems annually. This will result in a continuous use and rejuvenation cycle for

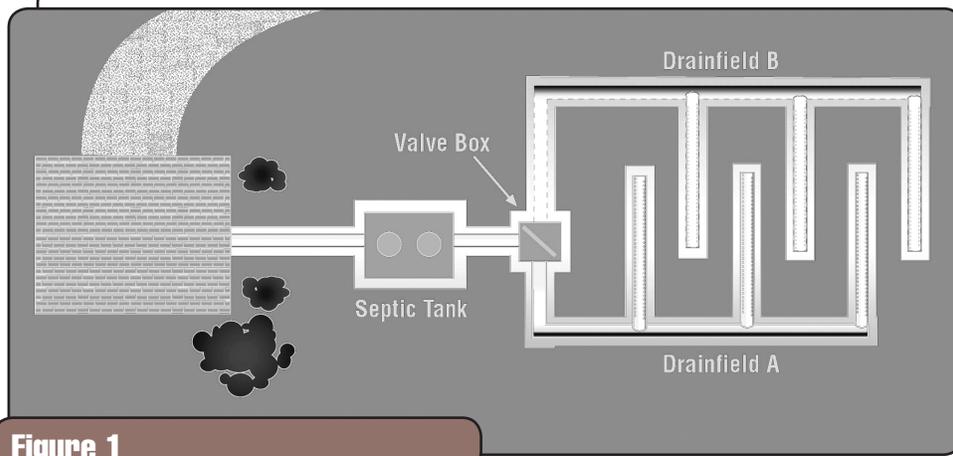


Figure 1

both drainfields and should prevent future failures. An observation tube in each drainfield may be used to monitor the condition of the drainfields and can help the homeowner determine the frequency of alternating between the two fields.

If an adequate area for a new system does not exist and the old system is a trench system with at least six feet of undisturbed soil between the trenches, it is possible to install new replacement trenches interlaced between the old ones. However, the plumbing for the new and old system must be entirely separate so that when one is in operation the other has the opportunity to completely dry out. (See Figure 1.)

Another option to reduce the organic load on the drainfield is by adding an advanced treatment system such as an aerobic treatment unit or a sand filter. Two previous issues of *Pipeline* describe these two technologies: Sand Filters (Summer 1997) and Home Aerobic Treatment Units (Winter 1996).

Sand filters and aerobic treatment units (ATUs) are systems that use natural processes to treat wastewater and are frequently used to renovate biologically clogged, failing septic tank-soil absorption units.

Typically, sand filters are used

as the second step in wastewater treatment after the septic tank where solids in raw wastewater have been separated out. Constructed of a bed of sand about two or three feet deep and often contained in a liner, sand filters receive the partially treated effluent in intermittent doses. The effluent slowly trickles through the media and is collected in an underdrain and flows to further treatment and/or disposal.

Sand filters are very effective at removing high levels of suspended solids and are capable of handling heavy hydraulic loads. These two qualities make them particularly useful in cases of drainfields that have been overloaded either hydraulically or biologically.

Aerobic treatment units are similar to septic tanks in that they use natural processes to treat wastewater, but unlike septic treatment, the ATU process requires oxygen. ATUs use a mechanism to inject and circulate air inside the treatment tank. Bacteria that thrive in oxygen-rich environments work to break down and digest the wastewater inside the aerobic treatment unit.

Aerobically treated effluent is defined as effluent exiting a properly operating ATU or sand filter. This additional step reduces the amount of total suspended solids (suspended solids value of less than 10-15 mg/L, compared to typical septic tank effluent

with suspended solids in the range of 100-250mg/L).

In situations where the soil absorption units have failed due to an excessive biomat formation, aerobic effluent reduces the symptoms. (Several states allow systems that are failing due to clogging biomat to be renovated using aerobically treated effluent, provided the site meets separation requirements between the aggregate/soil interfaces and limiting conditions of high water table or bedrock.)

References

- U.S. Environmental Protection Agency *Onsite Wastewater Treatment Systems Manual*, 2002. EPA/625/R-00/008.
- A Manual for Managing Septic Systems*, Sussex County Planning Dept. and New Jersey DEP & E, February, 1994.
- Winneberger, John H., et al. "Biological Aspects of Failure of Septic-Tank Percolation Systems" University of California, Berkeley, August 1960.
- Converse, James C. and E. Jerry Tyler. "Aerobically Treated Domestic Wastewater to Renovate Failing Septic Tank-Soil Absorption Fields." 8th Northwest On-site Wastewater Treatment Short Course and Equipment Exhibition *Proceedings*, 1995.
- Stuth, William L. and Matthew M. Lee. "Recovery of Failing Drainfields and a Sand Mound Using Aerobic Effluent." 9th National Symposium on Individual and Small Community Sewage Systems, 2001.
- "NSFC Q&A: Drainfield Clogging and Rehabilitation." *Small Flows Quarterly*, Spring 1999; Volume 13, No. 2., page 20.

Alternating Drainfields Provide Relief for a Failing System

When Dr. Todd Crocco saw wet, smelly sewage surfacing in his front yard, he knew that he had a problem. His 10-year-old septic system was failing. Crocco, a Morgantown, West Virginia resident, contacted the National Environmental Services Center.

When engineering scientists Ed Winant, Jennifer Hause, and Andrew Lake visited Crocco's home to assess the situation, they determined that the serial drainfield was failing. Winant said that serial drainfields are common in West Virginia where the ground is sloped.

A serial drainfield consists of a series of trenches. The first trench comes out of the septic tank and has an overflow pipe that leads from the first trench downhill to the second trench. The pipes have holes in the bottom, and when water comes into the pipe, it seeps out the bottom. When the trench becomes clogged, the water cannot seep out anymore and goes to the top of the pipe and into the overflow. The first trench must be completely filled up before water flows into the second trench and so on.

"You are only using one trench at a time, because once a trench has failed, it's not treating any more water. When there is nowhere else for it to go, it comes to the surface," Winant said. "A serial drainfield is always going to fail eventually."

NESC engineers found that the best solution to Crocco's problem was an alternating drainfield. A second drainfield was installed with three separate lines with distribution boxes to evenly distribute the flow. Modifications were made to the first drainfield by replacing the overflows with gravity manifold and distribution boxes.



A layout of the second drainfield. □□

"The water comes out of my tank and goes to a splitter valve. I run it to one field for two years, and then I can take off the cap, turn the valve, and send it to the opposite field for another two years," Crocco said. "The valve is below grade. You can't see it, and I can mow over top of it."

The National Environmental Services Center helps individuals and small communities all over the U.S. If you have a wastewater problem or question, contact our technical assistants at (304) 293-4191 or visit our Web site for more information on our services at www.nesc.wvu.edu.

